


TYPICAL SECTION - C201
SCALE = 1:20

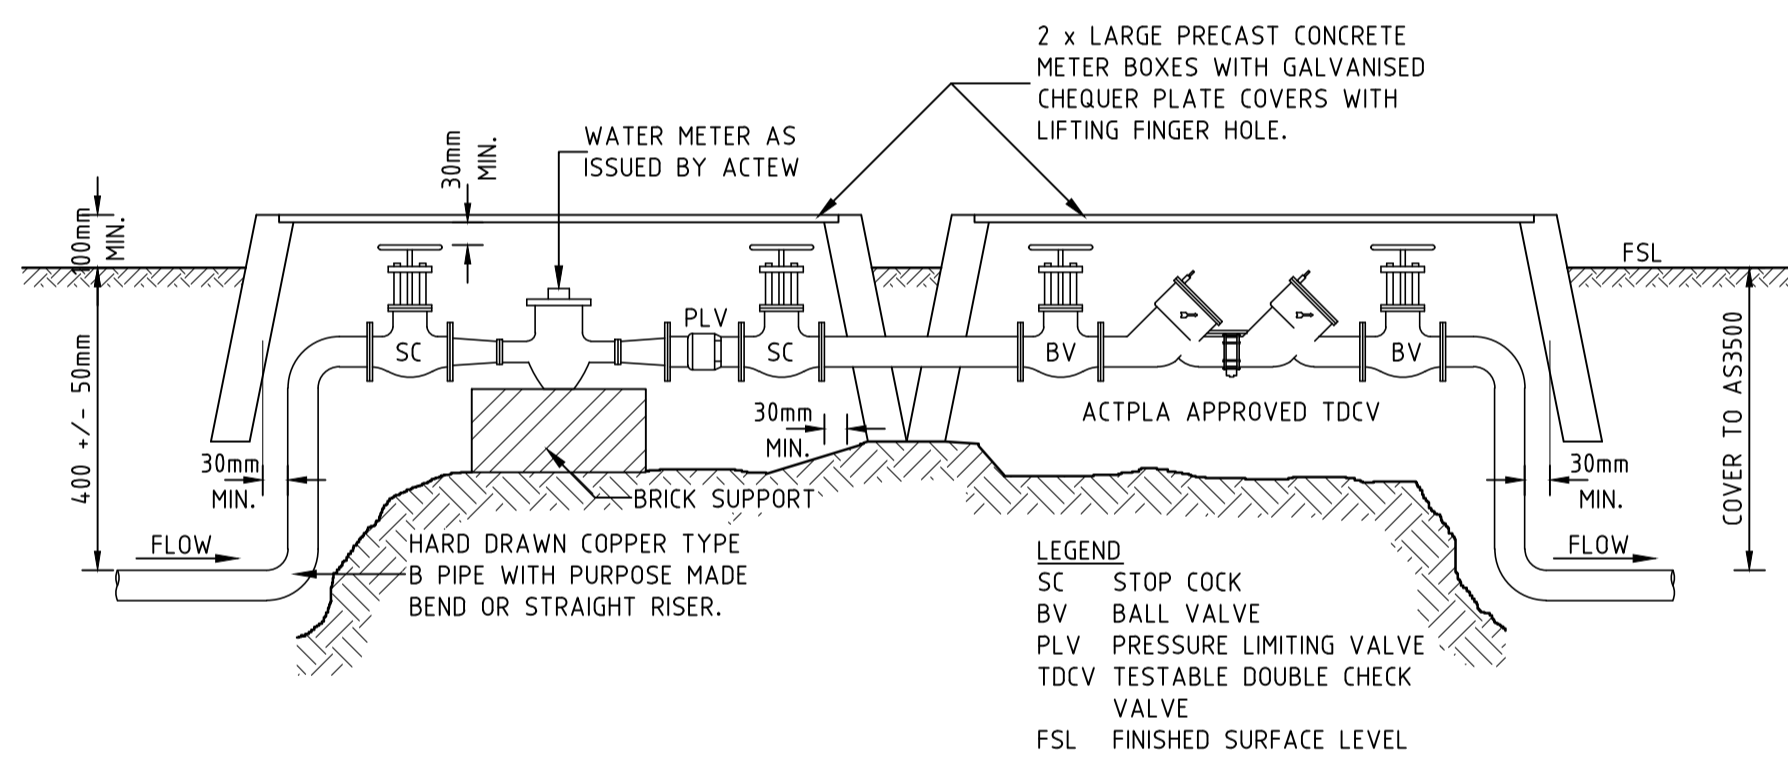

WATER METER DETAIL WITH TDCV
SCALE 1:10

WATER METER PIT NOTES

- FOR NONMETALLIC SERVICES A 1mm PVC COATED TRACER WIRE IS TO BE TAPED TO THE PIPE AND WOUND 3 TIMES AROUND THE COPPER RISER, THEN ATTACHED BENEATH THE METER COCK USING A COPPER OR BRASS CLAMP. IF DIRECT TAPPING TO A DICI MAIN, USE A BRASS ADAPTOR & CONNECT TRACE WIRE TO THE ADAPTOR. A BARBED AND TWISTED TRACE WIRE CONNECTION IS TO BE MADE WITH THE WATER MAIN. ELECTRICAL CONDUCTIVITY TO BE TESTED PRIOR TO BACKFILLING.
- MARKING TAPE TO AS2648 TO BE LAID 150mm ABOVE THE WATER SERVICE AND THE END BROUGHT TO THE SURFACE AND TIED BELOW THE METER COCK.
- ALL ITEMS ARE TO COMPLY WITH THE WATER SUPPLY & SEWERAGE REGULATIONS AND OTHER APPLICABLE LEGISLATION. METERS SHALL BE INSTALLED IN ACCORDANCE WITH AS3500.
- METER PIT TO BE IN A NON-TRAFFICABLE AREA WITH NO ENCUMBRANCES OVER WATER SERVICE AND METER.
- ACCESS TO METER PIT TO BE PROVIDED BY LEASEHOLDER IN A LOCATION WHICH DOES NOT REPRESENT A HAZARD TO CUSTOMERS OR ACTEW.
- BACKFLOW PREVENTION IS MANDATORY FOR IRRIGATION AND RAIN WATER TANK SYSTEMS. METER PIT TO HAVE 500mm HORIZONTAL CLEARANCE FROM ELECTRICAL SERVICES.
- THE INSTALLATION OF A 500kPa PRESSURE LIMITING VALVE MUST COMPLY WITH ACTPLA PLUMBING NOTE 23 AND AS3500.

ISSUE	DESCRIPTION	DATE	DRAWN	AMEND	DESCRIPTION	DATE	DRAWN
A	FOR DEVELOPMENT APPROVAL	30.06.14	CMO				
A	FOR REVIEW	06.06.14	CMO				

DO NOT SCALE OFF DRAWINGS. VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING WORK.
COPYRIGHT: The concepts and information contained in this document are copyright of Sellick Consultants. Use or copying of this document in whole or in part without written permission constitutes an infringement of copyright.

sellick consultants
po box 5005 braddon act 2612
p: 02 6201 0200 f: 02 6247 2203
sellickconsultants.com.au

PROJECT TITLE
PROPOSED BLOCK AMALGAMATION
CLIENT
ACT HOUSING

DESIGNED BY
CMO
CHECKED BY
BC
AUTHORISED BY
DATE
30/06/2014

DRAWING TITLE
EXTERNAL SERVICES DETAILS
PROJECT LOCATION
BLOCKS 20,22,23,24&25
SECTION 39, NARRABUNDAH

SCALE
NOT TO SCALE
JOB NO.
140028
DRAWING NO.
C202